



Ref. Certif. No.

AT 5043

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Recessed escape sign emergency luminaire

Name and address of the applicant

Zumtobel Lighting GmbH
Schweizer Str. 30,
6850 Dornbirn, Austria

Name and address of the manufacturer

Zumtobel Lighting GmbH
Schweizer Str. 30,
6850 Dornbirn, Austria

Name and address of the factory

Zumtobel Lighting GmbH
Schweizer Str. 30,
6850 Dornbirn, Austria

Note: When more than one factory, please report on page 2

Additional Information on page 2

Ratings and principal characteristics

220-240 V; 0/50/60 Hz; CI.I, IP20/IP40

Trademark / Brand (if any)

 ZUMTOBEL

Customer's Testing Facility (CTF) Stage used

CTF Stage 2

Model / Type Ref.

Series ARTSIGN...,
see page 3

Additional information (if necessary may also be reported on page 2)

Centrally supplied;
Light source classified as RG1(low risk).
See test report for information about National and/or Group Differences.

Additional Information on pages 2 to 4

A sample of the product was tested and found to be in conformity with

IEC 60598-1:2020
IEC 60598-2-2:2011
IEC 60598-2-22:2021

As shown in the Test Report Ref. No. which forms part of this Certificate

TR-251-0174-01, TR-251-0174-03

This CB Test Certificate is issued by the National Certification Body



Österreichischer Verband für Elektrotechnik

OVE Certification

Kahlenberger Str. 2A, 1190 Wien, Austria



Digitally signed by T. Neumayer

Email=t.neumayer@ove.at



Date: 2024-02-13

Signature: Dipl.-Ing. T. Neumayer



Ref. Certif. No.

AT 5043

Additional factory:

ZG Lighting SRB doo
Ulica Cumtobel br. 1,
18000 Nis, Serbia

Additional information (if necessary)

Digitally signed by T. Neumayer

Email=t.neumayer@ove.at

Signature: Dipl.-Ing. T. Neumayer

Date: 2024-02-13

Typecode:

ARTSIGN

Pictogram:

None

Escape direction

None

L, UPL, UP, UPR, R, DR, D, DL, LR, UPLR, DLR
E001 – E099 Evacuation route signs
F001 – F099..... Fire Equipment signs
M001 – M099 Mandatory action signs
P001 – P099 Prohibition signs
W001 – W099 Warning signs

Printed side

- 1..... One-sided
- 2..... Double-sided

Reference number ISO 7010

SP E001/E002
WP E026/E030
E001 – E099 Evacuation route signs
F001 – F099..... Fire Equipment signs
M001 – M099 Mandatory action signs
P001 – P099 Prohibition signs
W001 – W099 Warning signs

Luminaire Colour

WH White
BK Black
SR Silver

Supply version

ECC..... Emergency Central battery Circuit Monitoring
ECD..... Emergency Central battery DALI
ECP..... Emergency Central battery Powerline

Mounting version

MRC Mounting Recessed Ceiling
MRW Mounting Recessed Wall

Pictogram version

None, P

Pictogram height

None, 75

Product family**Additional information (if necessary)**Digitally signed by T. Neumayer
Email=t.neumayer@ove.at

Signature: Dipl.-Ing. T. Neumayer

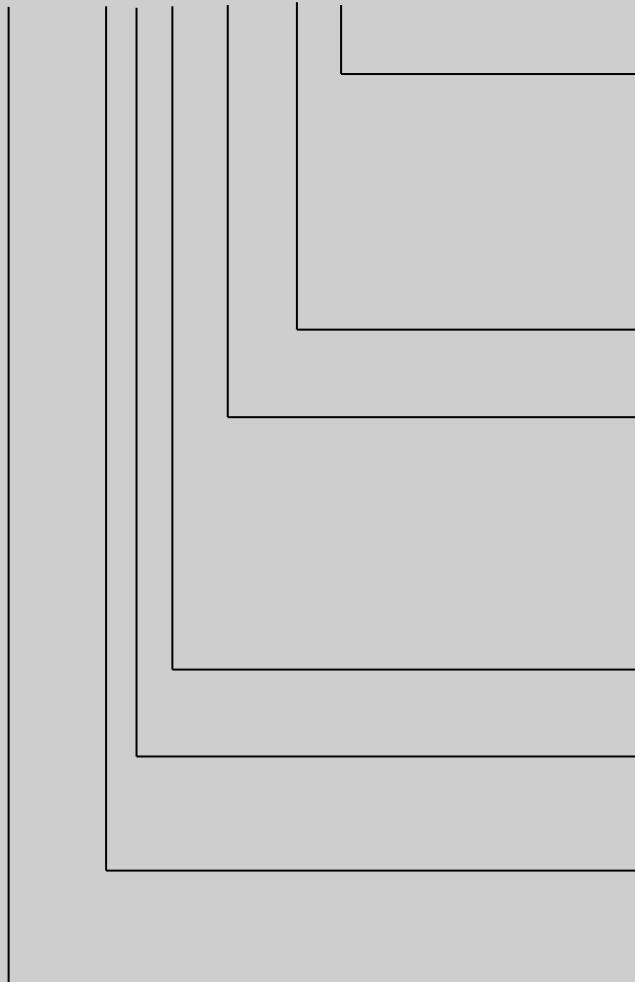
Date: 2024-02-13

Accessories:

ARTSIGN 75 P MRC FSR 12,5 mm
ARTSIGN 75 P MRW FSR 12,5 mm
ARTSIGN 75 P MRC FSR 25 mm
ARTSIGN 75 P MRW FSR 25 mm
ARTSIGN 75 P MSW housing
ARTSIGN 75 P MRC CCS
ARTSIGN 75 P MRW CCS
SAFTYSIGNS P BP Grid

Typecode Pictogram:

ARTSIGN - - -

**Escape direction**

None
L, UPL, UP, UPR, R, DR, D, DL, LR, UPLR, DLR
E001 – E099 Evacuation route signs
F001 – F099..... Fire Equipment signs
M001 – M099 Mandatory action signs
P001 – P099 Prohibition signs
W001 – W099 Warning signs

Printed side

1..... One-sided

Reference number ISO 7010

SP E001/E002
WP E026/E030
E001 – E099 Evacuation route signs
F001 – F099..... Fire Equipment signs
M001 – M099 Mandatory action signs
P001 – P099 Prohibition signs
W001 – W099 Warning signs

Mounting version

MRW

Pictogram version

None

P

Pictogram height

None

75

Product family**Additional information (if necessary)**

Digitally signed by T. Neumayer
Email=t.neumayer@ove.at

Signature: Dipl.-Ing. T. Neumayer

Date: 2024-02-13